


ENCELIUM WIRELESS AREA LIGHTING CONTROLLER (WALC) - WIRE TABLE

NOT USED WIRES
CAP OFF WIRE
END WITH UL
LISTED WIRE
NUT.

BLACK	LINE (IN) - RELAY CONTACT
RED	LINE (OUT) - RELAY CONTACT (SWITCHED HOT)
WHITE	NEUTRAL
VIOLET	NOT USED - CAP OFF PER CODE
GREY	NOT USED - CAP OFF PER CODE

WIRELESS AREA LIGHTING CONTROLLER

EN-ALC-ZB-BK
*EN-ALC-ZB-BK-DR
*DAMP RATED

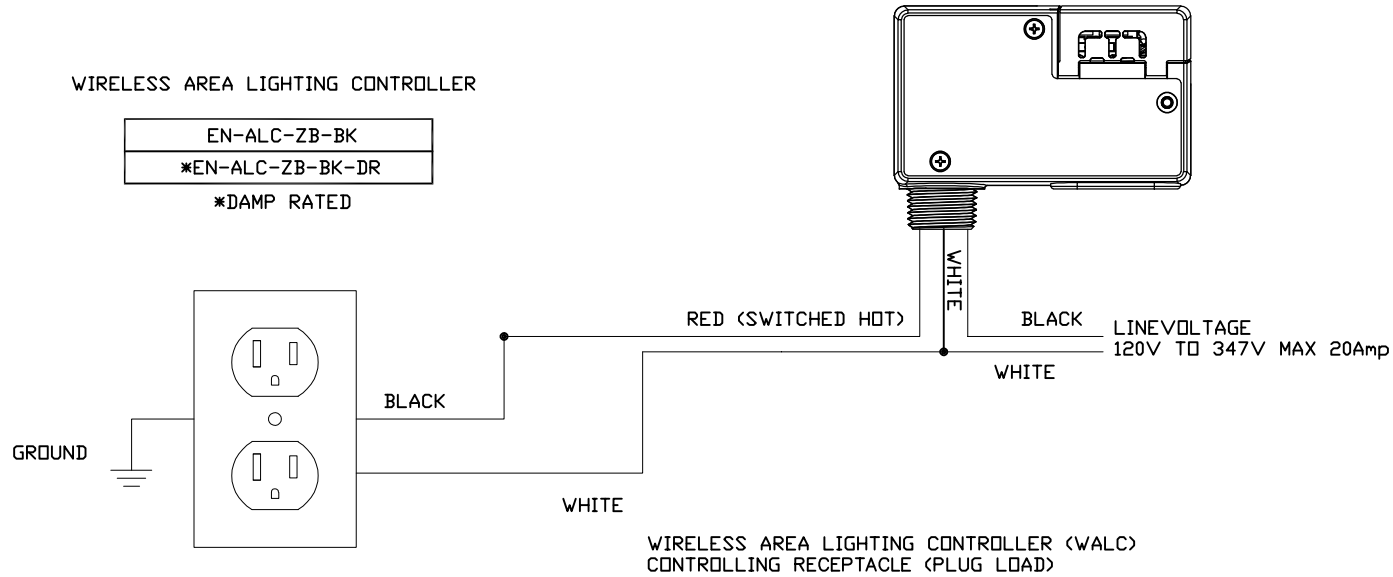

NOTES:

1. REFER TO MANUFACTURER'S SPECIFICATIONS FOR LOAD LIMITS AND DETAILED INSTALLATION INSTRUCTIONS.
2. WIRE UNIT IN ACCORDANCE WITH ALL APPLICABLE ELECTRICAL AND BUILDING CODES.
3. REFER TO ENCELIUM WIRELESS AREA LIGHTING CONTROLLER INSTALLATION AND SERVICE MANUAL BEFORE INSTALLING OR SERVICING MODULE.
4. FOR COMPATIBILITY WITH OTHER CONFIGURATIONS OR DRIVERS/BALLASTS ON ENCELIUM PRODUCTS CONTACT YOUR REPRESENTATIVE.
5. FOR SOME INSTALLATIONS, A JUNCTION BOX MAY BE REQUIRED. IT IS RECOMMENDED TO SECURELY MOUNT THE WALC TO THE JUNCTION BOX USING AN AVAILABLE 1/8 INCH KNOCK-OUT

REV	DESCRIPTION/CHANGE	DATE
<p>ENCELIUM www.encelium.com</p>		
TITLE <i>EN-ZB-007-R0-WALC-PLUG</i>		
SCALE <i>NTS</i>	PROJ NO. <i>-: -</i>	SIZE <i>A</i>
DRAWN <i>S.PANERI</i>	DWG. NO. <i>EN-ZB-007-R0</i>	
DATE <i>03-MAY-21</i>	FILE NAME <i>WALC-PLUG</i>	