



WIRELESS CONTROL MODULE

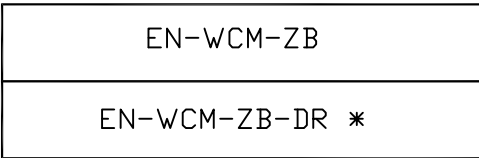


*FOR DAMP RATED LOCATIONS

ENCELIUM INDUSTRIAL CONTROLLER

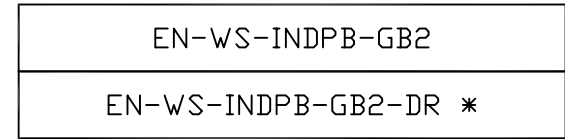


*FOR DAMP RATED LOCATIONS

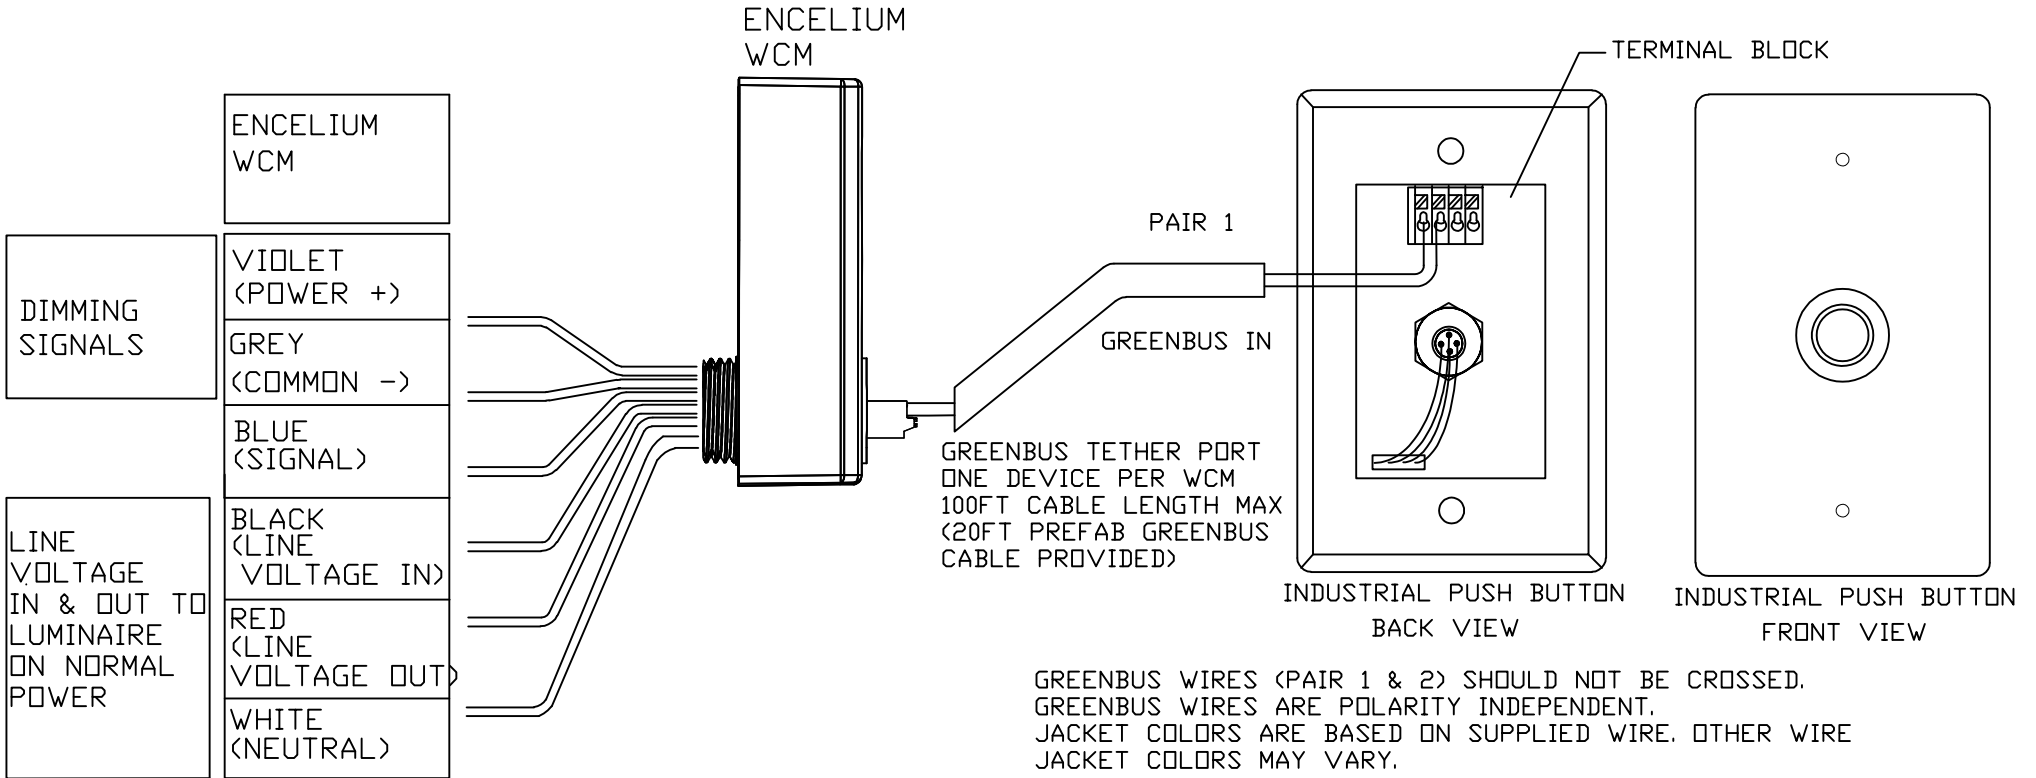

NOTES:

1. REFER TO ENCELIUM INSTALLATION AND SERVICE MANUAL BEFORE INSTALLING OR SERVICING UNIT.
2. WIRE UNIT IN ACCORDANCE WITH ALL APPLICABLE ELECTRICAL AND BUILDING CODES.
3. WIRE ONLY WITH CLASS 2, LOW VOLTAGE ENCELIUM GREENBUS PRETERMINATED CABLE WITH PLENUM (CMP/FTP) FLAME RATING.
4. FOR INTERCONNECTION DETAILS WITH OTHER DEVICES (BALLASTS, SENSORS, ETC.) REFER TO SPECIFIC INSTRUCTIONS FOR THE DEVICE OR CONTACT ENCELIUM.
5. USE OF APPROPRIATE ELECTRICAL JUNCTION BOX RECOMMENDED.
6. CONTAINS NO USER SERVICEABLE PARTS, REPLACE ENTIRE UNIT.
7. TO REMOVE THE GREENBUS CABLE, DEPRESS THE LOCKING MECHANISM.

cULus LISTED

| REV | DESCRIPTION/CHANGE | DATE |
|--|---|---------------|
|  www.encelium.com | | |
| TITLE <i>WCM TO INDPB</i> | | |
| SCALE <i>NTS</i> | PROJ. NO. <i>--</i> | |
| DRAWN <i>S.PANERI</i> | DWG. NO. <i>EN-ZB-016-RO</i> | SIZE <i>A</i> |
| DATE <i>28-MAY-21</i> | FILE NAME <i>EN-ZB-016-RO-WCM-INDPB</i> | |